

MPA | Eberswalde

# TEST CERTIFICATE

No. 31/21/4350/04 TC

CERTIFICATE HOLDER:

KNAUF GYPSOPIIA A.B.E.E.  
Euripidou Str. 10  
17674 Kalithea, Athens  
Greece


The product **GKBI – impregnated gypsum board 12,5 mm** (manufacturing plant: Gypsum Products Factory, 30500 Stanos, Amfilochia, Greece) was tested as product for walls (loading factor: 1,0 m<sup>2</sup>/m<sup>3</sup>) according to EN 16516 “Construction products: Assessment of release of dangerous substances – Determination of emissions into indoor air” and assessed according to evaluation procedures for VOC emissions from building products.

## GKBI – impregnated gypsum board 12,5 mm


complies with the following requirements for VOC emissions:

Belgian VOC regulation	✓
French VOC class A+	✓
German AgBB (2021) / ABG	✓
Finnish M1	✓
EMICODE EC1 <sup>Plus</sup>	✓
LEED v4.1 (low emitting materials; projects outside of the U.S.)*	✓

**MPA Eberswalde**  
**Materialprüfanstalt Brandenburg GmbH**  
28.06.2021

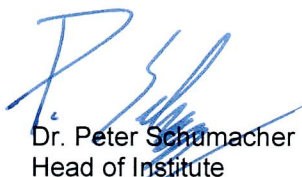  
Dr. Peter Schumacher  
Head of Institute

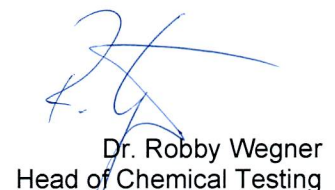

  
Dr. Robby Wegner  
Head of Chemical Testing

Details of testing: MPA test report 31/21/4350/04 of 28.06.2021: VOC emission chamber test (EN 16516)

\* The product meets the requirements as VOC emissions comply with Finnish M1 and EMICODE EC1<sup>Plus</sup>.

MPA Eberswalde is accredited under ISO/IEC 17025 for testing according to:  
CEN/TS 16516:2014, DIN EN 16516:2015, EN 16516:2017 and EN 16516:2017+A1:2020.